


DELETE REFERENCE TO 600AMLO LUGS FOR 2# 300MCM/Ø IN PANEL "MP" & PROVIDE 1000AMLO LUGS FOR 3# 350 MCM/Ø IN "MP"

DELETE ALL REFERENCES TO 4# 300MCM, 3" C & PROVIDE NEW 3# 350 MCM & 1# 2/0 NEUTRAL IN EACH OF 2 EXIST. SPARE 3" C.

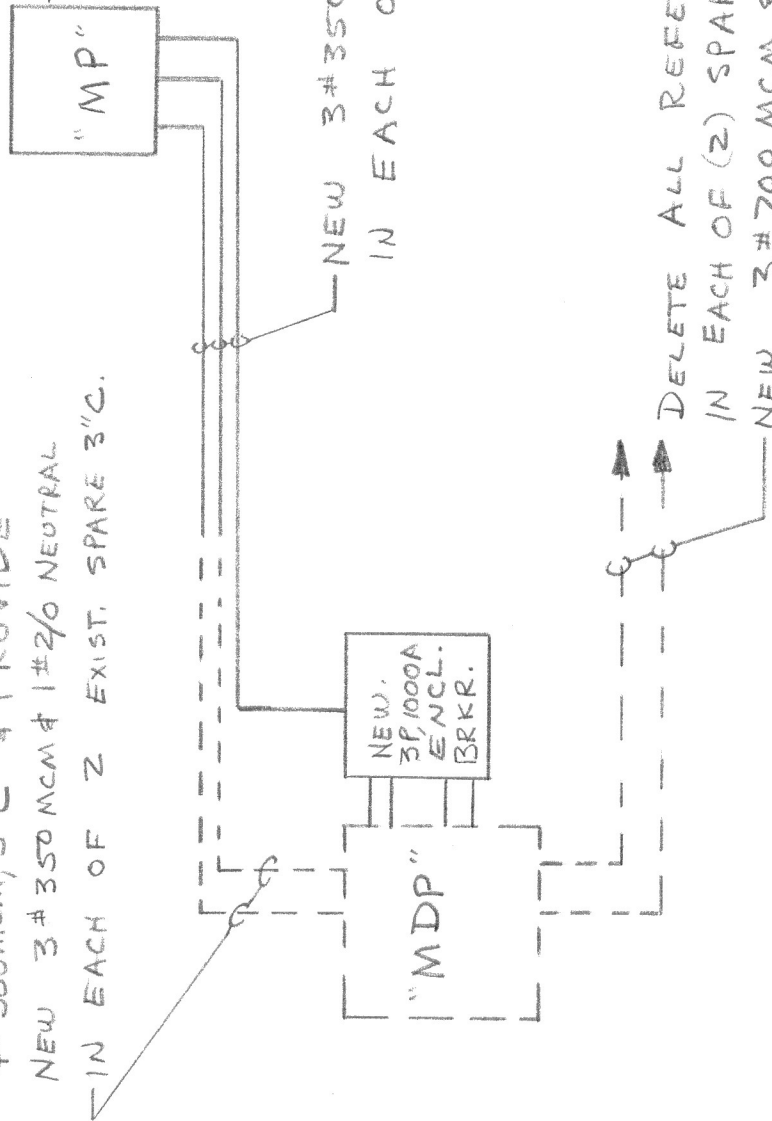

REVISIONS IN POWER RISER DIAGRAM
 No SCALE